Up/Down Counting Pulse Indicator

K3HB-C

CSM_K3HB-C_DS_E_7_1

Measure High-speed Up/down Pulses with this Up/down Pulse Meter.

 Perfect for Measuring Rotary Encoder and ON/OFF Pulse Signals at High Speed

Cumulative pulse input is 50 kHz, quadrature pulse inputs are 25 kHz, and up/down pulse inputs are 30 kHz.

Note: No-voltage contacts of up to 30 Hz are supported.

• The count value can be converted to any value.

The length equivalent for any pulse can be set to any desired value.

This is effective for feed amount and position monitor displays.

Refer to Safety Precautions for All Digital Panel





Model Number Structure

■ Model Number Legend

Base Units and Optional Boards can be ordered individually or as sets.

K3HB-C □

1. Input Sensor Code NB: NPN input/voltage pulse input

5. Supply Voltage

100-240 VAC: 100 to 240 VAC 24 VAC/VDC: 24 VAC/VDC

Optional Board

Sensor Power Supply/Output Boards

K33-

Relay/Transistor Output Boards

K34-□

Event Input Boards

K35-

Base Units with Optional Boards

K3HB-C - C 1 2 3 4

2. Sensor Power Supply/Output Type Code

None: None

CPA: Relay output (PASS: SPDT) + Sensor power supply

(12 VDC±10%, 80 mA) (See note 1.)

L1A: Linear current output (0 to 20 or 4 to 20 mA DC) + Sensor power supply

(12 VDC±10%, 80 mÅ) (See note 2.)

L2A: Linear voltage output (0 to 5, 1 to 5, or 0 to 10 VDC) + Sensor power

(12 VDC±10%, 80 mA) (See note 2.)

Sensor power supply (12 VDC ±10%, 80 mA) FLK1A: Communications (RS-232C) + Sensor power supply

(12 VDC±10%, 80 mA) (See note 2.)

FLK3A: Communications (RS-485) + Sensor power supply (12 VDC±10%, 80 mA) (See note 2.)

3. Relay/Transistor Output Type Code

None: None

Relay contact (HH/H/LL/L: SPST-NO each) C2·

Transistor (NPN open collector: HH/H/PASS/L/LL)

Transistor (PNP open collector: HH/H/PASS/L/LL)

BCD*:BCD output + transistor output (NPN open collector: HH/H/PASS/L/LL)

DRT: DeviceNet (See note 2.)

* A Special BCD Output Cable (sold separately) is required.

4. Event Input Type Code

None: None

1: 5 inputs (M3 terminal block), NPN open collector

8 inputs (10-pin MIL connector), NPN open collector 2.

5 inputs (M3 terminal block), PNP open collector

8 inputs (10-pin MIL connector), PNP open collector

Note: 1. CPA can be combined with relay outputs only.

2. Only one of the following can be used by each Digital Indicator: RS-232C/RS-485 communications, a linear output, or DeviceNet communications.

Accessories (Sold Separately)

K32-DICN: Special Cable (for event inputs with 8-pin connector)

K32-BCD: Special BCD Output Cable

Rubber Packing

	Model	
K32-P1		

Note: Rubber packing is provided with the Controller.

Specifications

■ Ratings

Supply voltage		100 to 240 VAC, 24 VAC/VDC, DeviceNet power supply: 24 VDC		
Allowable power supply voltage range		85% to 110% of the rated power supply voltage, DeviceNet power supply: 11 to 25 VDC		
Power consumption (See note 1.)	otion	100 to 240 VAC: 18 VA max. (max. load) 24 VAC/DC: 11 VA/7 W max. (max. load)		
Current consum	nption	DeviceNet power supply: 50 mA max. (24 VDC)		
Input		No-voltage contact, voltage pulse, open collector		
External power	supply	12 VDC±10% 80 mA		
Event inputs	Hold input	NPN open collector or no-voltage contact signal		
	Reset input	ON residual voltage: 2 V max. ON current at 0 Ω: 4 mA max.		
	Bank input	Max. applied voltage: 30 VDC max. OFF leakage current: 0.1 mA max.		
Output ratings (depends on the model)	Relay output	250 VAC, 30 VDC, 5 A (resistive load) Mechanical life expectancy: 5,000,000 operations, Electrical life expectancy: 100,000 operations		
the model)	Transistor output	Maximum load voltage: 24 VDC, Maximum load current: 50 mA, Leakage current: 100 μA max.		
Linear output		Linear output 0 to 20 mA DC, 4 to 20 mA DC: Load: 500 Ω max, Resolution: Approx. 10,000, Output error: ±0.5% FS Linear output 0 to 5 VDC, 1 to 5 VDC, 0 to 10 VDC: Load: 5 kΩ max, Resolution: Approx. 10,000, Output error: ±0.5% FS (1 V or less: ±0.15 V; no output for 0 V or less)		
Display method		Negative LCD (backlit LED) display 7-segment digital display (Character height: PV: 14.2 mm (green/red); SV: 4.9 mm (green))		
Main functions		Scaling function, measurement operation selection, output hysteresis, output OFF delay, output test, display value selection, display color selection, key protection, bank selection, display refresh period, maximum/minimum hold, reset		
Ambient operating temperature		−10 to 55°C (with no icing or condensation)		
Ambient operating humidity		25% to 85%		
Storage temperature		−25 to 65°C (with no icing or condensation)		
Altitude		2,000 m max.		
Accessories		Watertight packing, 2 fixtures, terminal cover, unit stickers, instruction manual. DeviceNet models also include a DeviceNet connector (Hirose HR31-5.08P-5SC(01)) and crimp terminals (Hirose HR31-SC-121) (See note 3.)		

- Note: 1. DC power supply models require a control power supply capacity of approximately 1 A per Unit when power is turned ON. Particular attention is required when using two or more DC power supply models. The OMRON S8VS-series DC Power Supply Unit is recommended.
 - 2. For K3HB-series DeviceNet models, use only the DeviceNet Connector included with the product. The crimp terminals provided are for Thin Cables.

2

■ Characteristics


Display range		-19,999 to 99,999							
Measurement range)	Functions F1, F2: ±2 gigacounts							
		Functions F3: 0 to 4 gigacounts							
Input signals		Contact input (dry contact input) (30 Hz max. with ON/OFF pulse width of 15 ms min.)							
		No contact voltage pulse Mode Input frequency ON/OFF ON voltage Pulse width ON voltage ON voltage				ON voltage	OFF voltage	Input impedance	
			F1	0 to 30 kHz	16 μs min.	4.5 to 30 V	–30 to 2 V	10 kΩ	
			F2	0 to 25 kHz	20 μs min.				
			F3	0 to 50 kHz	9 μs min.				
		Open collector	Mode	Input frequency range	ON/OFF pulse width	Note: The Up/Down Counting Pulse			
		F1 0 to 30 kHz 16 μs min.					Meter will malfunction if a pulse greater than the input frequency		
		F2 0 to 25 kHz 20 μs min.				range is input. SYSERR may			
			F3	0 to 50 kHz	9 μs min.	appe	ay.		
Connectable senso	rs	ON residual voltag OFF leakage curre Load current:	ent: 1.5 m Must						
Max. No. of display	diaits	5 (–19999 to 9999		be able to properly	3witch load co	IIICIII3 OI 3 IIIA	01 1033.		
Comparative output				ıt; 10 ms max.: Rel	av contact outr	out			
time	. тооролоо	(time until the com to 95% or 95% to	parative o 15%)	output is made whe	n there is a forc	ed sudden char			
Linear output respo		input signal from 1	5% to 95	nal analog output v % or 95% to 15%)		d when there is	a forced sudde	n change in the	
Insulation resistance	e	20 M Ω min. (at 50	0 VDC)						
Dielectric strength		2,300 VAC for 1 m	in betwee	en external termina	lls and case				
Noise immunity		100 to 240 VAC models: ±1,500 V at power supply terminals in normal or common mode (waveform with 1-ns rising edge and pulse width of 1 μs/100 ns) 24 VAC/VDC models: ±1,500 V at power supply terminals in normal or common mode (waveform with 1-ns rising edge and pulse width of 1 μs/100 ns)							
Vibration resistance		Frequency: 10 to 55 Hz; Acceleration: 50 m/s², 10 sweeps of 5 min each in X, Y, and Z directions							
Shock resistance		150 m/s ² (100 m/s ² for relay outputs) 3 times each in 3 axes, 6 directions							
Weight		Approx. 300 g (Base Unit only)							
Degree of Front panel Conforms to NEMA 4X for indoor use (e				r use (equivalent to IP66)					
protection	Rear case	IP20							
	Terminals	IP00 + finger prote	ection (VE	DE0106/100)					
Memory protection		EEPROM (non-vo	latile mer	nory)					
Applicable standard	is	UL61010C-1, CSA C22.2 No. 1010.1 (evaluated by UL) EN61010-1 (IEC61010-1): Pollution degree 2/Overvoltage category II EN61326: 1997, A1: 1998, A2: 2001							
EMC		EMI: EN61326 industrial applications Electromagnetic radiation interference CISPR 11 Group 1, Class A Terminal interference voltage CISPR 11 Group 1, Class A EMS: EN61326 industrial applications Electrostatic Discharge Immunity EN61000-4-2: 4 kV (contact), 8 kV (in air) Radiated Electromagnetic Field Immunity EN61000-4-3: 10 V/m sine wave amplitude modulation (80 MHz to 1 GHz, 1.4 to 2 GHz) Electrical Fast Transient/Burst Noise Immunity EN61000-4-4: 2 kV (power line), 1 kV (I/O signal line) Surge Immunity EN61000-4-5: 1 kV with line (power line), 2 kV with ground (power line)							
		Conducted Disturbance Immunity EN61000-4-6: 3 V (0.15 to 80 MHz) Power Frequency Magnetic Immunity EN61000-4-8: 30 A/m (50 Hz) continuous time Voltage Dips and Interruptions Immunity EN61000-4-11: 0.5 cycle, 0°/180°, 100% (rated voltage)							

Operation

■ Functions (Operating Modes)

F1 to F3

Function name	Function No.
Individual inputs	F!
Phase differential inputs	F2
Pulse counting input	F3

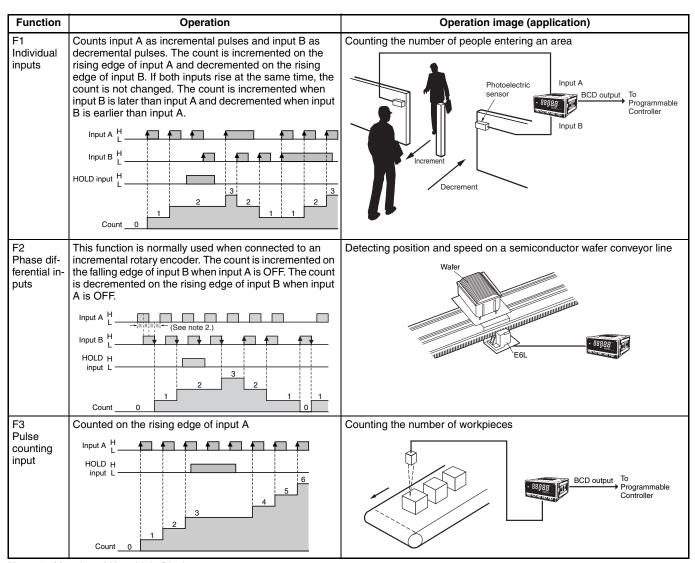

Note: 1. Meaning of H and L in Display

Symbol	Input method	No-voltage input
Н		Short-circuit
L		Open

2. Requires at least half the minimum signal width. If there is less than half, a ± 1 count error may occur.

Input Type Setting

	NO: Voltage pulse high	NC: Voltage pulse low
No-contact or voltage pulse input	00	0 !
Contact	10	11

■ What Is Prescaling?


Prescaling converts the count value to any numeric value.

To display \(\subseteq \subseteq \subseteq \) mm in a system that outputs 250 pulses for a 0.5-m feed,

the length per pulse = 500 mm (0.5 m) \div 250 = 2.

1. The prescale value for the K3HB-C is set using the mantissa $X \times$ exponent Y, so the prescale value = $2.0000 \times 10^{\circ}$, X = 2.000, and Y = 00.

2. Next, set the decimal point position for one digit to the right of the decimal point: \(\alpha \alpha \alpha \alpha \alpha \alpha \)



Common Specifications

■ Event Input Ratings

K3HB-P/-C	HOLD, RESET, BANK1, BANK2, BANK4		
Contact	ON: 1 k Ω max., OFF: 100 k Ω min.		
No-contact	ON residual voltage: 2 V max.		
	OFF leakage current: 0.1 mA max.		
	Load current: 4 mA max.		
	Maximum applied voltage: 30 VDC max.		

■ Output Ratings

Contact Output

Item	Resistive loads (250 VAC, cosφ=1; 30 VDC, L/R=0 ms)	Inductive loads (250 VAC, closed circuit, cos∳=0.4; 30 VDC, L/R=7 ms)	
Rated load	5 A at 250 VAC		
Rated through current	5 A		
Mechanical life expectancy	5,000,000 operations		
Electrical life expectancy	100,000 operations		

Transistor Outputs

Maximum load voltage	24 VDC
Maximum load current	50 mA
Leakage current	100 μA max.

Linear Output

Item	Outputs	0 to 20 mA	4 to 20 mA	0 to 5 V	1 to 5 V	0 to 10 V
Allowable load impedance		500 Ω max.		5 kΩ min.		
Resolution Approx. 10,000						
Output error ±0.5% FS			±0.5% FS (±0.15 V for 1 V or less and no output for 0 V)			

Serial Communications Output

Item Type	RS-232C, RS-485
Communications method	Half duplex
Synchronization method	Start-stop synchronization (asynchronous)
Baud rate	9600/19200/38400 bps
Transmission code	ASCII
Data length	7 bits or 8 bits
Stop bit length	2 bits or 1 bit
Error detection	Vertical parity and FCS
Parity check	Odd, even

BCD Output I/O Ratings (Input Signal Logic: Negative)

I/O signal name		Item		Rating		
Inputs	REQUEST CCOMPEN- SATION RESET	Input signal		Input signal		No-voltage contact input
		Input current for no-voltage input		10 mA		
		Signal level	ON voltage	1.5 V max.		
			OFF voltage	3 V min.		
Outputs	DATA POLARITY OVER DATA VALID RUN	Maximum load voltage		24 VDC		
		Maximum load current		10 mA		
		Leakage current		100 μA max.		
	OUT1 OUT2 OUT3 OUT4 OUT5	Maximum load voltage		24 VDC		
		Maximum load current		50 mA		
		Leakage current		100 μA max.		

Refer to the *K3HB Communications User's Manual* (Cat. No. N129) for details on serial and DeviceNet communications.


DeviceNet Communications

Communications protocol		Conforms to Device	Conforms to DeviceNet						
Supported communications	Remote I/O	Master-Slave connec	Master-Slave connection (polling, bit-strobe, COS, cyclic)						
	communications	Conforms to Device	Conforms to DeviceNet communications standards.						
	I/O allocations	Allocate any I/O data	Allocate any I/O data using the Configurator.						
		Allocate any data, su	Allocate any data, such as DeviceNet-specific parameters and variable area for Digital Indicators						
		Input area: 2 blocks,	Input area: 2 blocks, 60 words max.						
			Output area: 1 block, 29 words max. (The first word in the area is always allocated for the Output Execution Enabled Flags.)						
	Message	Explicit message cor	Explicit message communications						
	communications	CompoWay/F communications commands can be executed (using explicit message communications)							
Connection meth	ods	Combination of multi-	Combination of multi-drop and T-branch connections (for trunk and drop lines)						
Baud rate		DeviceNet: 500, 250,	DeviceNet: 500, 250, or 125 Kbps (automatic follow-up)						
Communications media		Special 5-wire cable (2	Special 5-wire cable (2 signal lines, 2 power supply lines, 1 shield line)						
Communications distance		Baud rate	Network length (max.)	Drop line length (max.)	Total drop line length (max.)				
		500 Kbps	100 m max. (100 m max.)	6 m max.	39 m max.				
		250 Kbps	100 m max. (250 m max.)	6 m max.	78 m max.				
		125 Kbps	100 m max. (500 m max.)	6 m max.	156 m max.				
		The values in parenth	The values in parentheses are for Thick Cable.						
Communications	power supply	24-VDC DeviceNet po	24-VDC DeviceNet power supply						
Allowable voltage	fluctuation range	11 to 25-VDC DeviceN	11 to 25-VDC DeviceNet power supply						
Current consump	otion	50 mA max. (24 VDC)	50 mA max. (24 VDC)						
Maximum numbe	r of nodes	64 (DeviceNet Configu	64 (DeviceNet Configurator is counted as one node when connected.)						
Maximum number of slaves		63	63						
Error control checks		CRC errors	CRC errors						
DeviceNet power supply		Supplied from Device!	Supplied from DeviceNet communications connector						

Connections

■ External Connection Diagrams


Terminal Arrangements

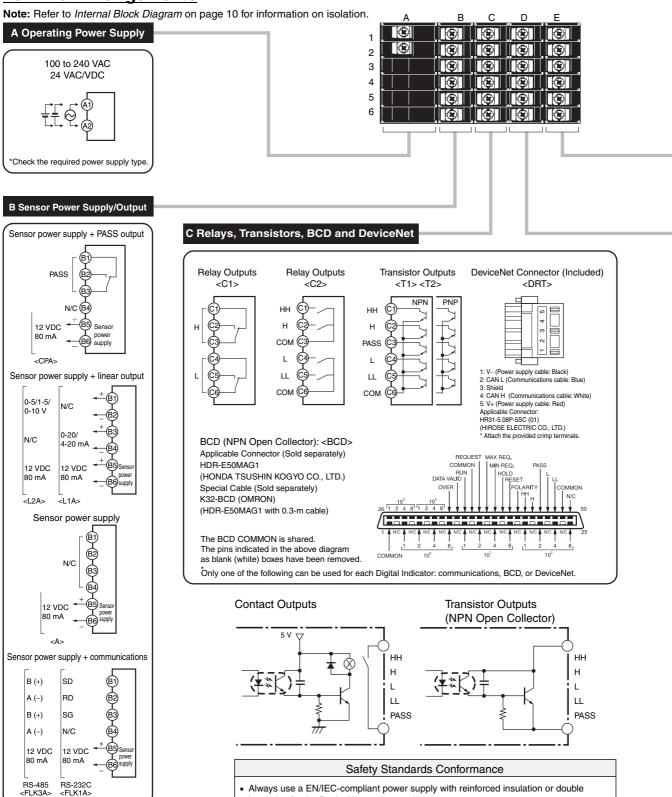

insulation for the DeviceNet power supply.

• The product must be used indoors for the above applicable standards to apply.

3

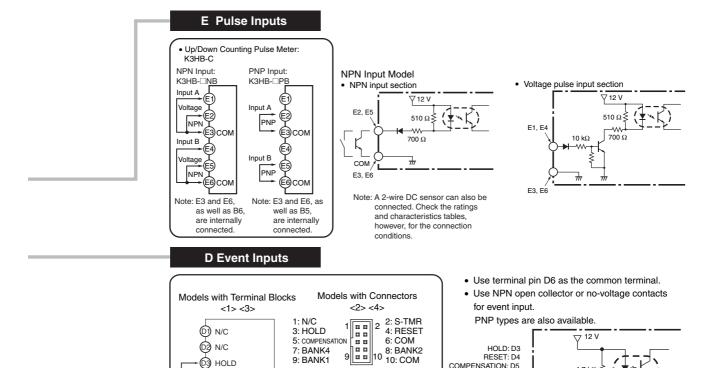


Applicable Connector (Sold separately) XG4M-1030 (OMRON)

Special Cable (Sold separate

K32-DICN (OMBON) (XG4M-1030 with 3-m cable)

Note: The actual terminal label abbreviates "COMPENSATION" to "CMP."

BCD Output Cable

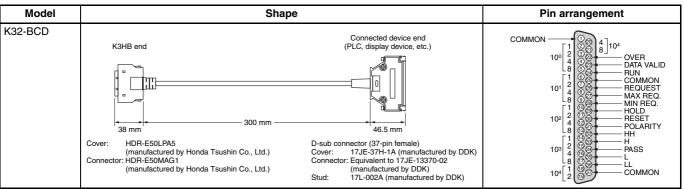

COMPENSATION: D5

COM

3.9 kΩ

7

Note: The BCD Output Cable has a D-sub plug. Cover: 17JE-37H-1A (manufactured by DDK); Connector: equivalent to 17JE-23370-02 (D1) (manufactured by DDK)

Special Cable (for Event Inputs with 8-pin Connector)

RESET

COMPENSATION


03

• СОМ

Model	Appearance		Wiring		
K32-DICN	9 10 2 3,000 mm Cable marking (3 m)	•	Pin No. 1 2 3 4 5 6 7 8 9 10	Signal name N/C S-TMR HOLD RESET N/C COM BANK4 BANK2 BANK1 COM	


■ Derating Curve for Sensor Power Supply (Reference Values)

For 12V



- **Note: 1.** The above values were obtained under test conditions with the standard mounting. The derating curve will vary with the mounting conditions, so be sure to adjust accordingly.
 - 2. Internal components may be deteriorated or damaged. Do not use the Digital Indicator outside of the derating range (i.e., do not use it in the area labeled ①, above).


■ Internal Block Diagram

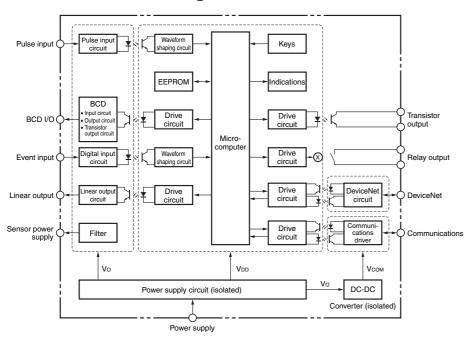

■ BCD Output Timing Chart


A REQUEST signal from a Programmable Controller or other external device is required to read BCD data.

Single Sampling Data Output

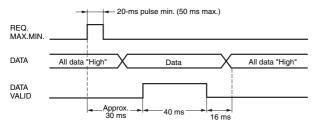

The data is set in approximately 30 ms from the rising edge of the REQUEST signal and the DATA VALID signal is output. When reading the data from a Programmable Controller, start reading the data when the DATA VALID signal turns ON. The DATA VALID signal will turn OFF 40 ms later, and the data will turn OFF 16 ms after that.


Continuous Data Output

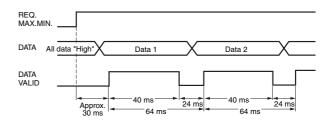


Measurement data is output every 64 ms while the REQUEST signal remains ON.

Note: If HOLD is executed when switching between data 1 and data 2, either data 1 or data 2 is output depending on the timing of the hold signal. The data will not go LOW.

• The K3HB BCD output model has an open collector output, so wired OR connection is possible



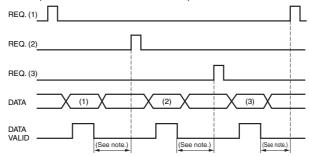


Note: Leave 20 ms min. between DATA VALID turning OFF and the REQUEST signal.

Programmable Controller Connection Example

Display Unit Connection Example

the pin number for the Digital Indicator narrow pitch connector (manufactured by

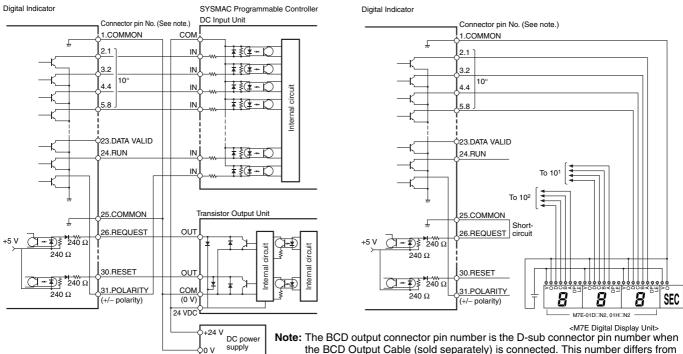


Refer to the following User's Manual for application precautions and other information required when using the Digital Indicator: K3HB-R/P/C Digital Indicator User's Manual (Cat. No. N136)


Honda Tsushin Kogyo Co., Ltd.).

The manual can be downloaded from the following site in PDF format: OMRON Industrial Web http://www.fa.omron.co.jp

■ Component Names and Functions

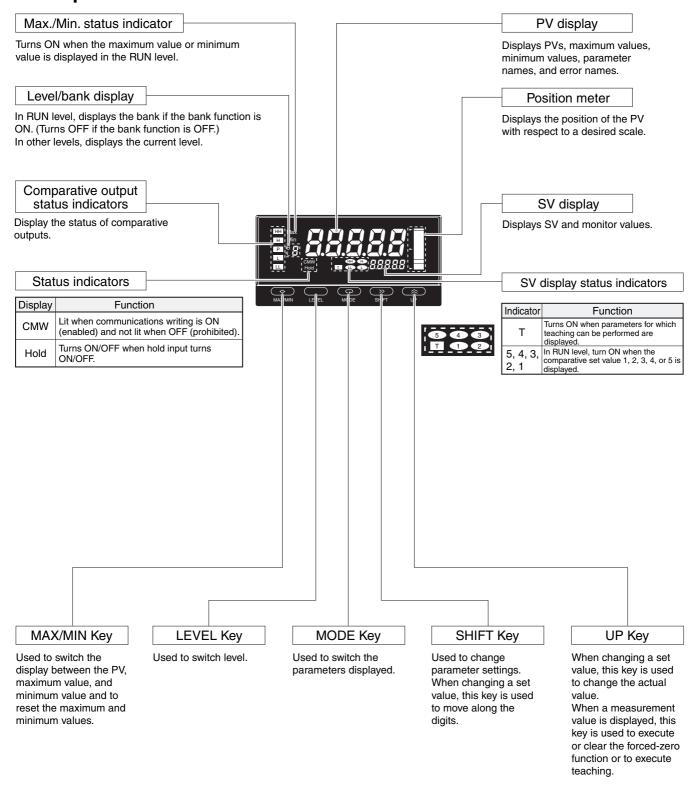

■ Dimensions

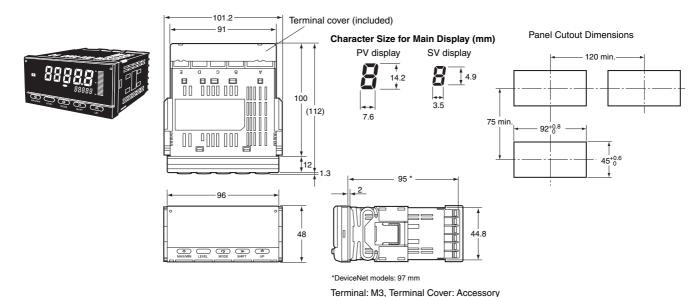


Wiring Precautions

- For terminal blocks, use the crimp terminals suitable for M3 screws.
- Tighten the terminal screws to the recommended tightening torque of approx. 0.5 N⋅m.
- To prevent inductive noise, separate the wiring for signal lines from that for power lines.

Wiring

• Use the crimp terminals suitable for M3 screws shown below.



Unit Stickers (included)


- No unit stickers are attached to the Digital Indicator.
- Select the appropriate units from the unit sticker sheets provided.




Note: For measurements for commercial purposes, be sure to use the unit required by any applicable laws or regulations.

Mounting Method

- 1. Insert the K3HB into the mounting cutout in the panel.
- Insert watertight packing around the Unit to make the mounting watertight.




Insert the adapter into the grooves on the left and right sides of the rear case and push until it reaches the panel and is fixed in place.



LCD Field of Vision

The K3HB is designed to have the best visibility at the angles shown in the following diagram.



Rubber Packing (Sold Separately)

K32-P1



If the rubber packing is lost or damaged, it can be ordered using the following model number: K32-P1.

(Depending on the operating environment, deterioration, contraction, or hardening of the rubber packing may occur and so, in order to ensure the level of waterproofing specified in NEMA4, periodic replacement is recommended.)

Note: Rubber packing is provided with the Controller.

Main Functions

■ Main Functions and Features

Measurement

Function

FUnE

The K3HB-R has the following six functions for receiving and displaying input pulses.

F1: Rotation (rpm)/circumferential speed

F2: Absolute ratio

F3: Error ratio

F4: Rotational difference

F5: Flow rate ratio

F6: Passing time

The K3HB-P has the following six functions for receiving and displaying input pulses.

F1: Passing speed

F2: Cycle

F3: Time difference

F4: Time band

F5: Measuring length

F6: Interval

The K3HB-C has the following three functions for receiving and displaying input pulses.

F1: Individual inputs

F2: Phase differential inputs

F3: Pulse counting input

Filters

Input Types

こっとお、こっとと、こっとお

Specify the types of sensor connected to input A and input B.

Compensation

Compensation

[ăňPn, [ăň-P

The display can be changed to a preset compensation value using the compensation input.

Key Operations

Teaching

The present measurement value can be used as a scaling value.

Key Protection

Key protection restricts level or parameter changes using the keys to prevent unintentional key operations and malfunctions.

Outputs

Comparative Output Pattern

Zone and level comparative output patterns can be selected for comparative outputs.

Output OFF Delay

FF-d

Delays turning OFF comparatives for a set period. This can be used to provide sufficient time to read the comparative output ON status when the comparative result changes at short intervals.

Shot Output

SHāŁ

Turns ON the comparative output for a specific time.

Output Logic

āUt-n

Reverses the output logic of comparative results.

Output Test

LESE

Output operation can be checked without using actual input signals by using the keys to set a test measurement value.

Linear Outputs

L5E&£, L5E&w, L5E&H, L5E&£

A current or voltage proportional to the change in the measurement value can be output.

Standby Sequence

5Edby

The comparison outputs can be kept OFF until the measurement value enters the PASS range.

Display

Display Value Selection __ d\ 5P

The display value can be set to the present value, the maximum value, or the minimum value.

Display Color Selection

The present value display color can be set to green or red. The color of the present value can also be switched according to the comparative output.

Display Refresh Period d. EF

When the input changes rapidly, the display refresh period can be lengthened to control flickering and make the display easier to read.

Position Meter Post-L, Post-H, Post-L

The present measurement value can be displayed as a position in relation to the scaling width on a 20-gradation position meter.

Prescale P5AJ, P5AY, P5.bJ, P5.bY

The input signal can be converted and displayed as any value.

Comparative Set Value Display 5u.d5P

Select whether or not to display the comparative value during operation.

Display auto-return CEL

Automatically returns the display to RUN level when there are no key operations (e.g., max./min. switching, bank settings using keys).

Other

Bank Selection bn P-[

Switch between 8 comparative value banks using the keys on the front panel or external inputs. A set of set comparative values can be selected as a group.

Bank Copy [5P4

Any bank settings can be copied to all banks.

Interruption Memory

The measured value can be recorded when the power supply is interrupted.

ALL DIMENSIONS SHOWN ARE IN MILLIMETERS.

To convert millimeters into inches, multiply by 0.03937. To convert grams into ounces, multiply by 0.03527.

In the interest of product improvement, specifications are subject to change without notice.